


Data sheet

Differential pressure controller (PN 16)

AVP - return and flow mounting, adjustable setting
AVP-F - return mounting, fixed setting

Description

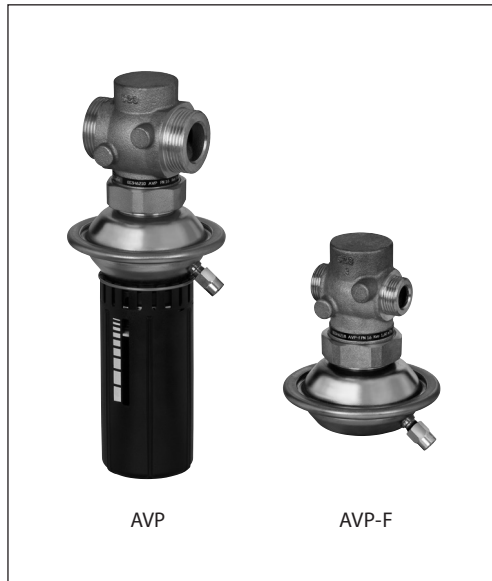

AVP(-F) is a self-acting differential pressure controller primarily for use in district heating systems. The controller closes on rising differential pressure. The controller has a control valve, an actuator with one control diaphragm and handle for differential pressure setting (fixed setting version is without handle).

Main data:

- DN 15-32
- k_{vs} 0.4-10 m³/h
- PN 16
- Setting range (AVP): 0.05-0.5 bar / 0.2-1.0 bar / 0.8-1.6 bar
- Fixed setting (AVP-F): 0.2 bar / 0.3 bar / 0.5 bar
- Temperature:
 - Circulation water / glycolic water up to 30%: 2 ... 150 °C
- Connections:
 - Ext. thread (weld-on, thread and flange tailpieces)

Ordering

AVP Controller (return mounting)

Picture	DN (mm)	k_{vs} (m ³ /h)	Connection		Δp setting range (bar)	Code No.	Δp setting range (bar)	Code No.	Δp setting range (bar)	Code No.
	15	1.6	Cylindr. ext. thread acc. to ISO 228/1	G 3/4 A	0.05-0.5	003H6200	0.2-1.0	003H6206	0.8-1.6	003H6212
		2.5				003H6201		003H6207		003H6213
		4.0				003H6202		003H6208		003H6214
		6.3				003H6203		003H6209		003H6215
	25	8.0	G 1 A	003H6204		003H6210		003H6216		
	32	10	G 1 1/4 A	003H6205		003H6211		003H6217		
			G 1 1/4 A							

Example 1:

Differential pressure controller; return mounting; DN 15; k_{vs} 1.6; PN 16; setting range 0.2-1.0 bar; T_{max} 150 °C; ext. thread;

- 1x AVP DN 15 controller Code No: **003H6206**
- 1x Impulse tube set AV, R 1/8 Code No: **003H6852**

Option:

- 1x Weld-on tailpieces Code No: **003H6908**

The controller will be delivered completely assembled, inclusive impulse tube between valve and actuator. External impulse tube (AV) must be ordered separately.

AVP Controller (flow mounting)

Picture	DN (mm)	k_{vs} (m ³ /h)	Connection		Δp setting range (bar)	Code No.	Δp setting range (bar)	Code No.
	15	0.4	Cylindr. ext. thread acc. to ISO 228/1	G 3/4 A	0.05-0.5	-	0.2-1.0	003H6947 ¹⁾
		1.0				-		003H6948 ¹⁾
		1.6				003H6238		003H6244
		2.5				003H6239		003H6245
		4.0				003H6240		003H6246
		6.3				003H6241		003H6247
	20	8.0	G 1 A	003H6242		003H6248		
	25		G 1 1/4 A					
	32	10	G 1 1/4 A	003H6243		003H6249		

¹⁾ This version of controller can be mounted in return or in flow pipe. When ordering 2 impulse tube sets AV (instead of 1) should be ordered (see ordering example 2).

Ordering (continuous)

AVP-F Controller (return mounting)

Picture	DN (mm)	k _{vs} (m ³ /h)	Connection	Δp setting range (bar)	Code No.	Δp setting range (bar)	Code No.	Δp setting range (bar)	Code No.	
	15	1.6	Cylindr. ext. thread acc. to ISO 228/1	0.2	003H6218	0.3	003H6224	0.5	003H6230	
		2.5			003H6219				003H6225	003H6231
		4.0			003H6220				003H6226	003H6232
		6.3			003H6221				003H6227	003H6233
		8.0			003H6222				003H6228	003H6234
	20	6.3	G 1 A	0.2	003H6223	0.3	003H6229	0.5	003H6235	
	25	8.0	G 1 1/4 A							
	32	10	G 1 3/4 A							

Example 2:
Differential pressure controller; flow mounting; DN 15; k_{vs} 0.4; PN 16; setting range 0.2-1.0 bar; T_{max} 150 °C; ext. thread;

- 1x AVP DN 15 controller
Code No: **003H6947**
- 1x Impulse tube set AV, R 1/8
Code No: **003H6852**

Option:
- 1x Weld-on tailpieces
Code No: **003H6908**

The controller will be delivered completely assembled, inclusive impulse tube between valve and actuator. External impulse tube (AV) must be ordered separately.

Accessories

Picture	Type designation	DN	Connection	Code No.
	Weld-on tailpieces	15	-	003H6908
		20		003H6909
		25		003H6910
		32		003H6911
	External thread tailpieces	15	Conical ext. thread acc. to EN 10226-1	R 1/2 003H6902
		20		R 3/4 003H6903
		25		R 1 003H6904
		32		R 1 1/4 003H6905
	Flange tailpieces	15	Flanges PN 25, acc. to EN 1092-2	003H6915
		20		003H6916
		25		003H6917
	Impulse tube set AV	Description: - 1x copper tube Ø 6 × 1 × 1500 mm - 1x compression fitting ¹⁾ for imp. tube connection to pipe Ø 6 × 1 mm		R 1/8 003H6852
				R 3/8 003H6853
				R 1/2 003H6854
				¹⁾ 10 compression fittings for imp. tube connection to pipe, Ø 6 × 1 mm R 1/8 003H6857
				¹⁾ 10 compression fittings for imp. tube connection to pipe, Ø 6 × 1 mm R 3/8 003H6858
				¹⁾ 10 compression fittings for imp. tube connection to pipe, Ø 6 × 1 mm R 1/2 003H6859
				¹⁾ 10 compression fittings for imp. tube connection to actuator, Ø 6 × 1 mm G 1/8 003H6931
	Shut off valve Ø 6 mm			003H0276

¹⁾ Compression fitting consists of a nipple, compression ring and nut.

Service kits

Picture	Type designation	DN	k _{vs} (m ³ /h)	Code No.		
				AVP(-F) return	AVP(-F) flow	
	Valve insert	15	0.4	-	003H6869	
			1.0	-	003H6870	
			1.6	003H6863	003H6871	
			2.5	003H6864	003H6872	
			4.0	003H6865	003H6873	
		20	6.3	003H6866	003H6874	
		25	8.0	003H6867	003H6875	
32	10					
	Actuator with adjustable handle (AVP)			Code No.		
				0.05-0.5	003H6821	003H6823
				0.2-1.0	003H6822	003H6824
	0.8-1.6					
	Actuator without adjustable handle (AVP-F)				Code No.	
0.2					003H6825	-
0.3						
0.5						

Technical data

Valve


Nominal diameter	DN	15					20	25	32
k_{VS} value	m ³ /h	0.4	1.0	1.6	2.5	4.0	6.3	8.0	10
Cavitation factor z		≥ 0.6						≥ 0.55	
Leakage acc. to standard IEC 534	% of k_{VS}	≤ 0.02							≤ 0.05
Nominal pressure	PN	25							
Max. differential pressure	bar	12							
Medium		Circulation water / glycolic water up to 30%							
Medium pH		Min. 7, Max. 10							
Medium temperature	°C	2...150							
Connections	valve	External thread							
	tailpieces	Weld-on and external thread							
		Flange							-
Materials									
Valve body		Red bronze CuSn5ZnPb (Rg5)							
Valve seat		Stainless steel, mat. No. 1.4571							
Valve cone		Dezincing free brass CuZn36Pb2As							
Sealing		EPDM							
Pressure relieve system		Piston							

Actuator


Type	AVP			AVP-F			
Actuator size	cm ²	39					
Nominal pressure	PN	16					
Diff. pressure setting ranges and spring colours	bar	0.05-0.5	0.2-1.0	0.8-1.6	0.2	0.3	0.5
		grey	black		(fixed setting)		
Materials							
Actuator housing		Zinc plated, DIN 1624, No. 1.0338					
Diaphragm		EPDM					
Impulse tube		Copper tube Ø 6 x 1 mm					

Application principles

- Return mounting

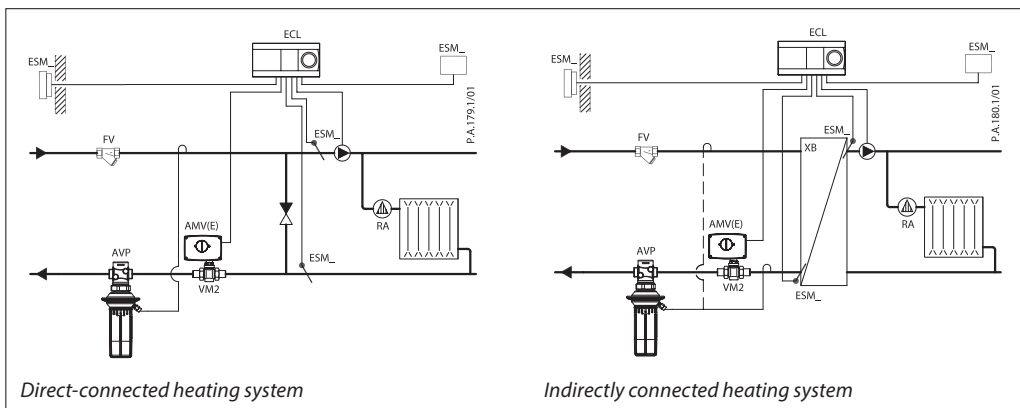



Application principles
- Flow mounting

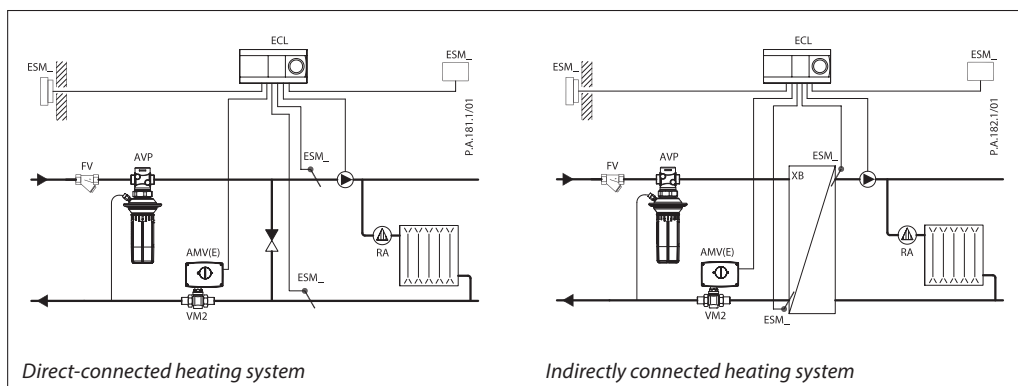


Installation positions

Up to medium temperature of 100 °C the controllers can be installed in any position.

For higher temperatures the controllers have to be installed in horizontal pipes only, with a pressure actuator oriented downwards.

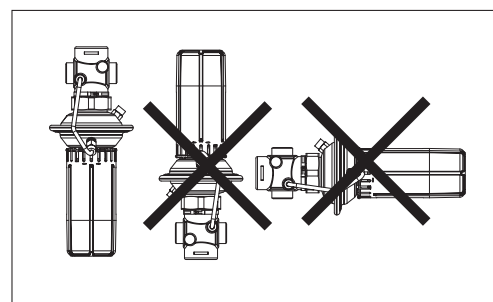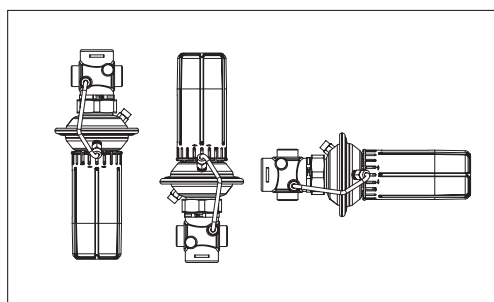

Pressure temperature diagram

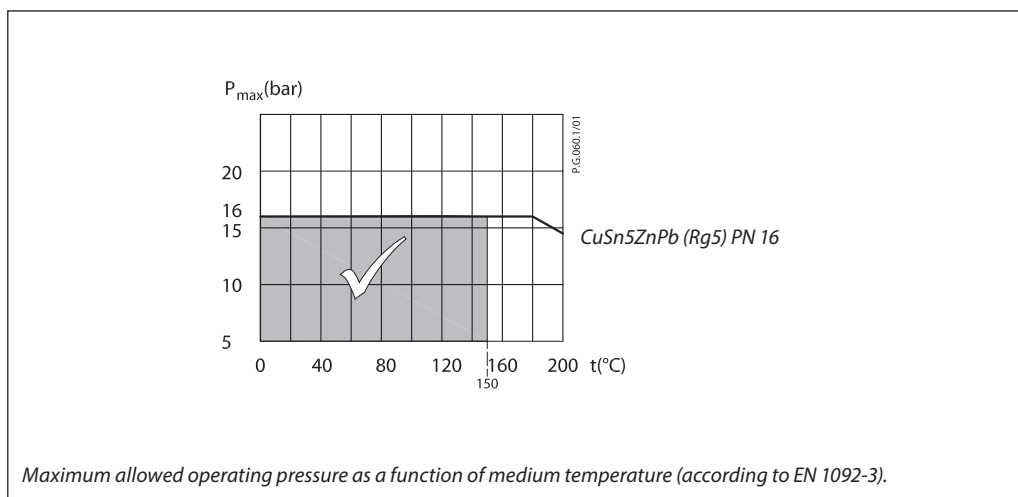

Sizing

- Directly connected heating system

Example 1

Motorised control valve (MCV) for mixing circuit in direct-connected heating system requires differential pressure of 0.2 bar (20 kPa).

Given data:

- Q_{max} = 1.3 m³/h (1300 l/h)
- Δp_{min} = 0.7 bar (70 kPa)
- * $\Delta p_{circuit}$ = 0.1 bar (10 kPa)
- Δp_{MCO} = 0.2 bar (20 kPa) selected

***Remark**

$\Delta p_{circuit}$ corresponds to the required pump pressure in the heating circuit and is not to be considered when sizing the AVP

The differential pressure set value is:

$$\Delta p_{set\ value} = \Delta p_{MCO}$$

$$\Delta p_{set\ value} = 0.2\ bar\ (20\ kPa)$$

The total pressure loss across the controller is:

$$\Delta p_{AVP} = \Delta p_{min} - \Delta p_{MCO} = 0.7 - 0.2$$

$$\Delta p_{AVP} = 0.5\ bar\ (50\ kPa)$$

Possible pipe pressure losses in tubes, shut-off fittings, heatmeters, etc. are not included.

k_v value is calculated according to formula:

$$k_v = \frac{Q_{max}}{\sqrt{\Delta p_{AVP}}} = \frac{1.3}{\sqrt{0.5}}$$



$$k_v = 1.8\ m^3/h$$

or read from the sizing diagram, page 7, by taking a line from Q-scale (1.3 m³/h) through Δp_v -scale (0.5 bar) to intersect k_v -scale at 1.8 m³/h.

Solution:

The example selects AVP DN 15, k_{vS} value 2.5, with differential pressure setting range 0.05-0.5 bar.

The P-band (Xp) can also be read from the sizing diagram. Take a horizontal line from the k_v -scale (1.8 m³/h) to the right to intersect the X_p -scale (0.04 bar). At a set value of 0.2 bar and a X_p of 0.04 bar the AVP controller controls between 0.2 bar with open motorised control valve and 0.2 + 0.04 = 0.24 bar at almost closed motorised control valve (i.e. total pressure loss across the motorised control valve).

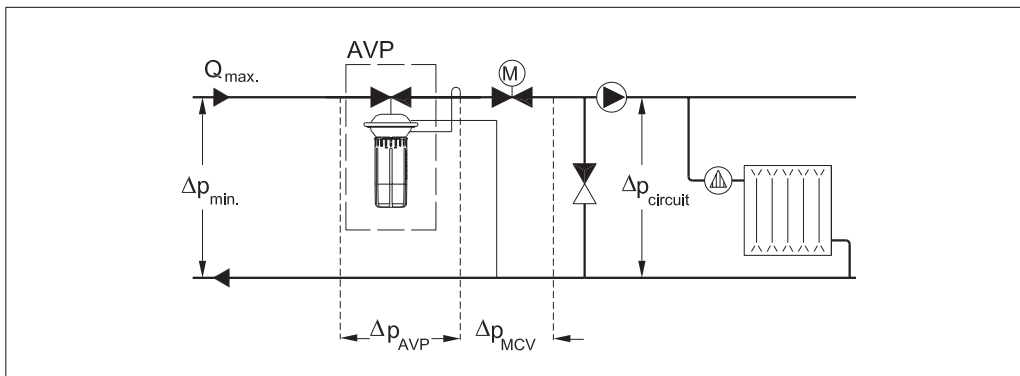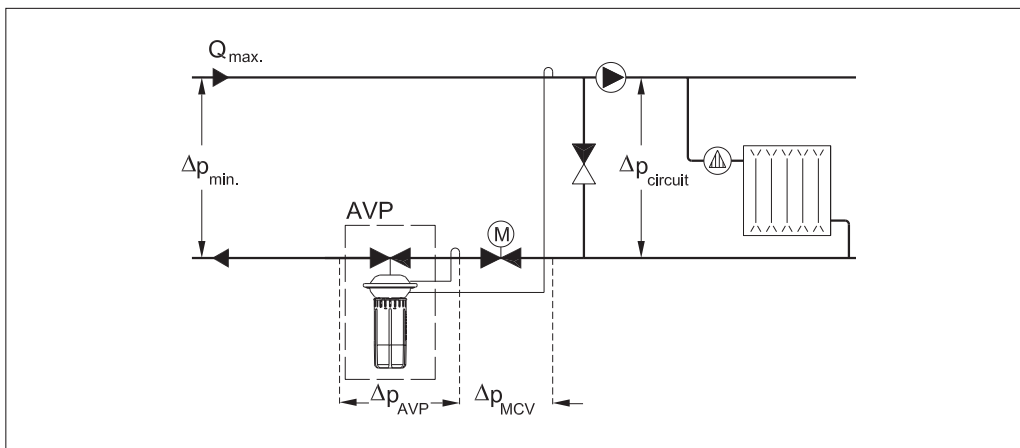

Sizing (continuous)

- Indirectly connected heating system

Example 2

Motorised control valve (MCV) for indirectly connected heating system requires differential pressure of 0.3 (30 kPa) bar.

Given data:

- Q_{max} = 0.8 m³/h (800 l/h)
- Δp_{min} = 0.8 bar (80 kPa)
- $\Delta p_{exchanger}$ = 0.05 bar (5 kPa)
- Δp_{MCV} = 0.3 bar (30 kPa) selected

The differential pressure set value is:

$$\Delta p_{set\ value} = \Delta p_{exchanger} + \Delta p_{MCV} = 0.05 + 0.3$$

$$\Delta p_{set\ value} = 0.35\ \text{bar (35 kPa)}$$

The total pressure loss across the controller is:

$$\Delta p_{AVP} = \Delta p_{min} - \Delta p_{exchanger} - \Delta p_{MCV}$$

$$= 0.8 - 0.05 - 0.3$$

$$\Delta p_{AVP} = 0.45\ \text{bar (45 kPa)}$$

Possible pipe pressure losses in tubes, shut-off fittings, heatmeters, etc. are not included.

k_v value is calculated according to formula:

$$k_v = \frac{Q_{max}}{\sqrt{\Delta p_{AVP}}} = \frac{0.8}{\sqrt{0.45}}$$



$$k_v = 1.2\ \text{m}^3/\text{h}$$

or read from the sizing diagram, page 7, by taking a line from Q -scale (0.8 m³/h) through Δp_v -scale (0.45 bar) to intersect k_v -scale at 1.2 m³/h.


Solution:

The example selects AVP DN 15, k_{v5} value 1.6, with differential pressure setting range 0.05-0.5 bar.

The P-band (X_p) can also be read from the sizing diagram. Take a horizontal line from the k_v -scale (1.2 m³/h) to the right to intersect the X_p -scale (0.04 bar). At a set value of 0.35 bar and a X_p of 0.04 bar the AVP controller controls between 0.35 bar with open motorised control valve and 0.35 + 0.04 = 0.39 bar at almost closed motorised control valve (i.e. total pressure loss across the motorised control valve).

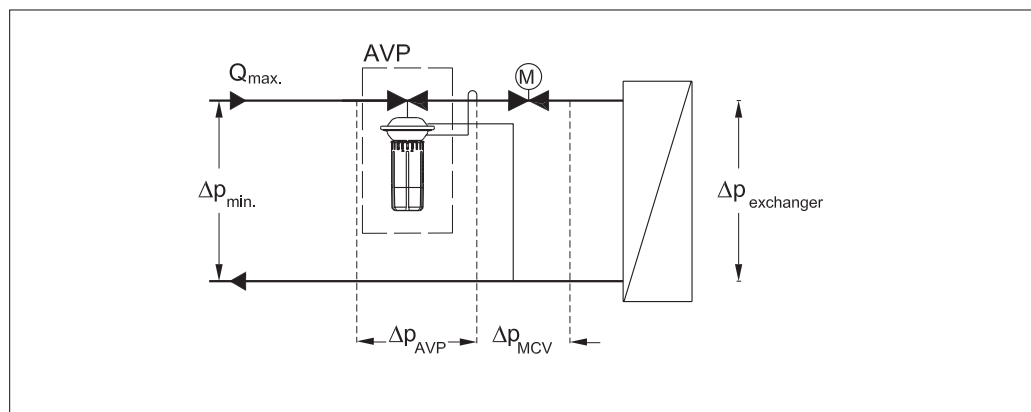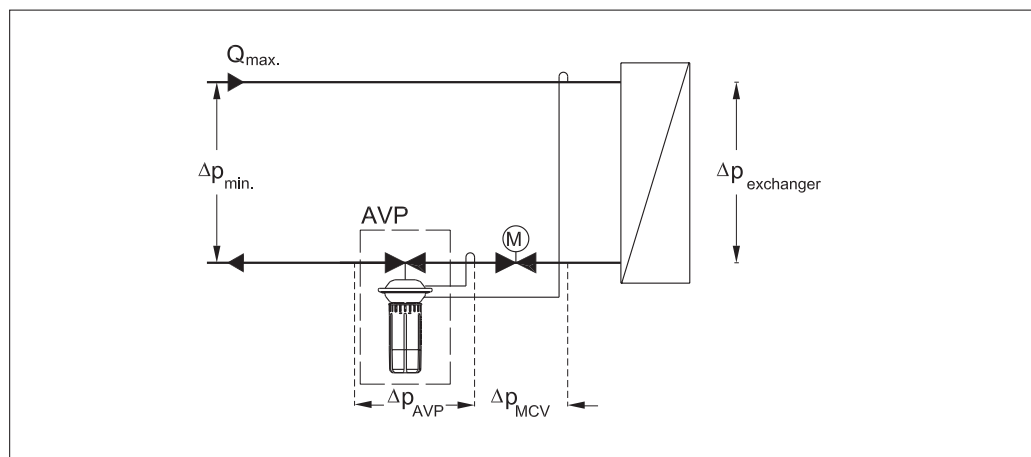


Sizing (continuous)

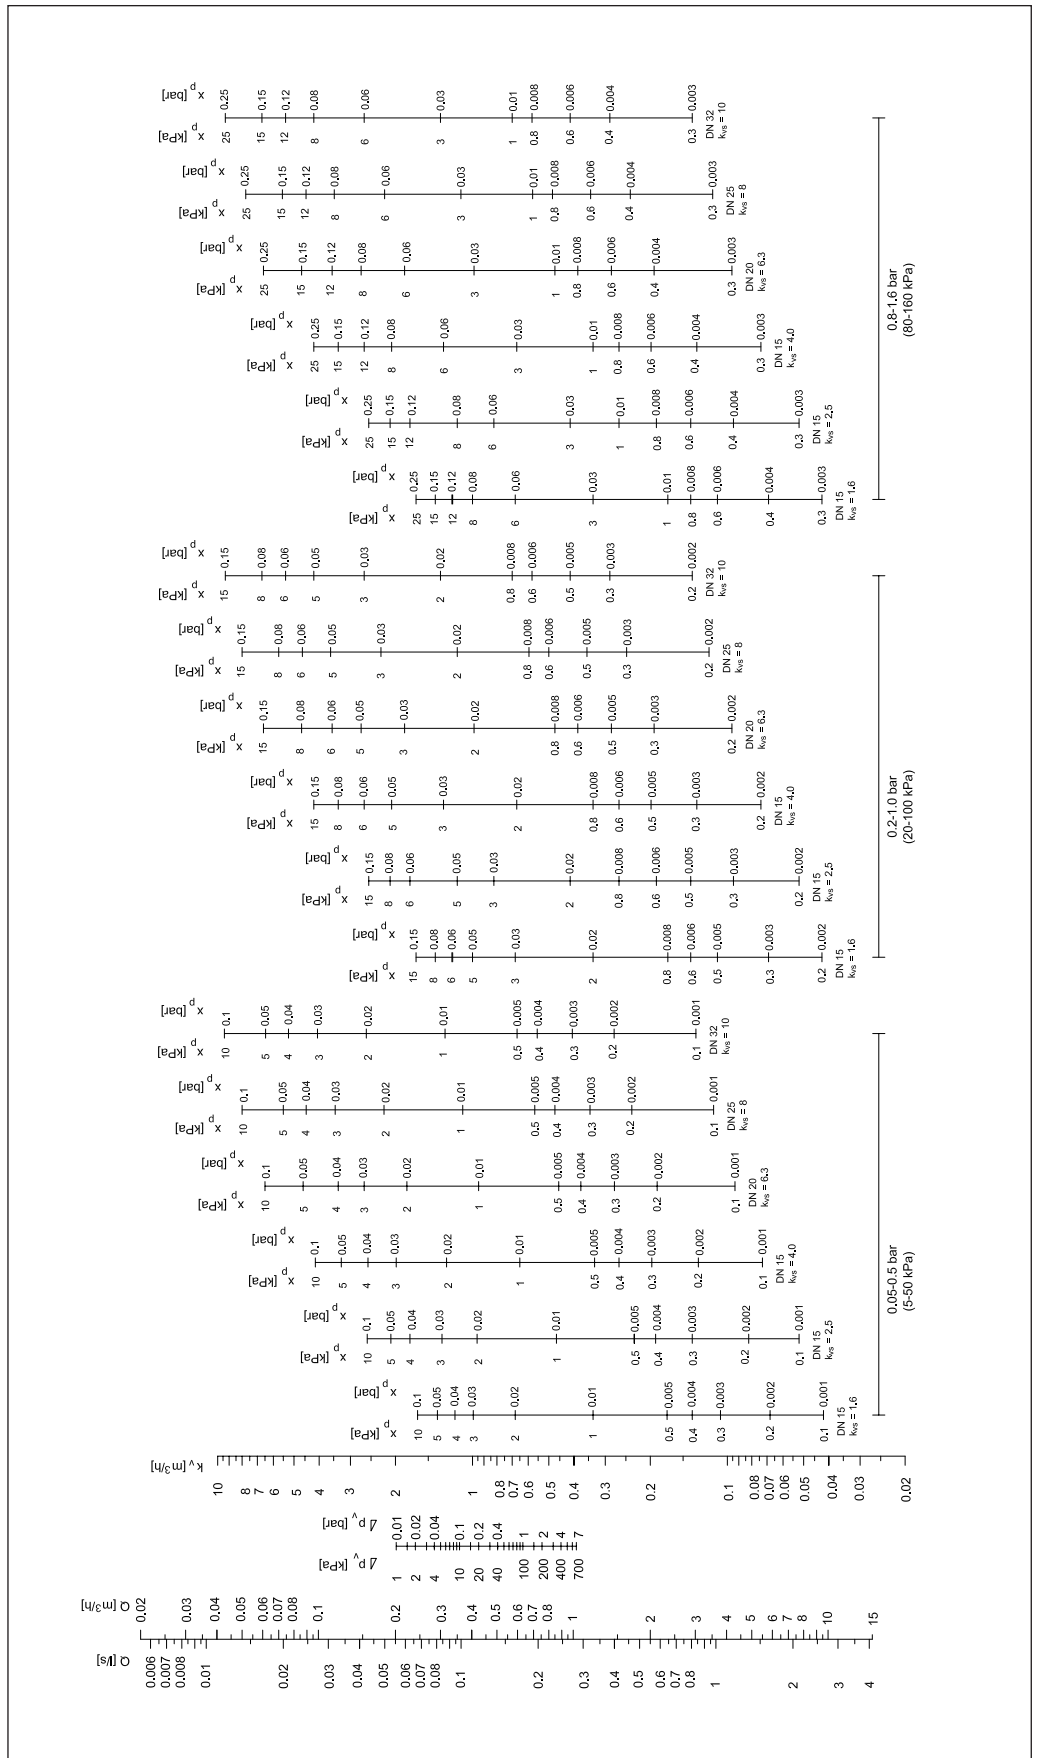

Select suitable controller size. X_p should not exceed 50% of the controller differential pressure setting.

Design

1. Valve body
2. Valve insert
3. Pressure relieved valve cone
4. Valve stem
5. Control drain
6. Actuator
7. Control diaphragm for diff. pressure control
8. Setting spring for diff. pressure control
9. Handle for diff. pressure setting, prepared for sealing
10. Union nut
11. Compression fitting for impulse tube
12. Excess pressure safety valve

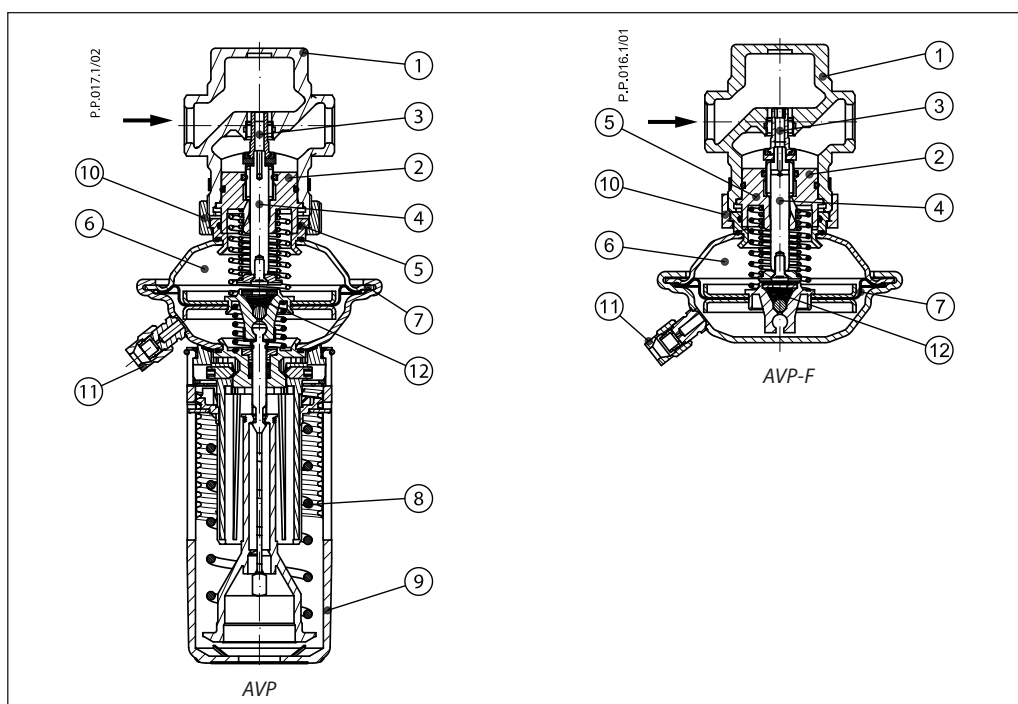

Function

Pressure changes from flow and return pipes are being transferred through the impulse tubes and/or control drain in the actuator stem to the actuator chambers and act on control diaphragm for diff. pressure control. The diff. pressure is controlled by means of setting spring for diff. pressure control. Control valve closes on rising differential pressure and opens on falling differential pressure to maintain constant differential pressure.


Controller is equipped with excess pressure safety valve, which protects control diaphragm for diff. pressure control from too high differential pressure.

Settings


Differential pressure setting
 Differential pressure setting (valid for AVP controller only) is being done by the adjustment of the setting spring for diff. pressure control. The adjustment can be done by means of handle for diff. pressure setting and/or pressure indicators.

Adjustment diagram

Relation between scale figures and differential pressure. Values given are approximate.

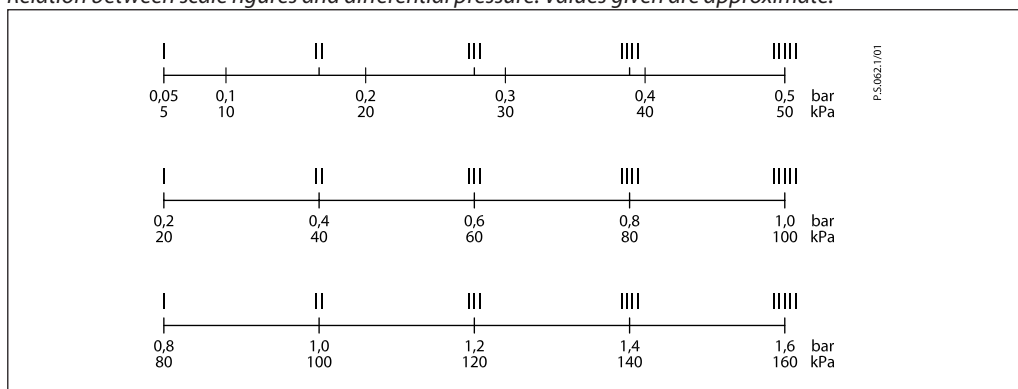

Dimensions

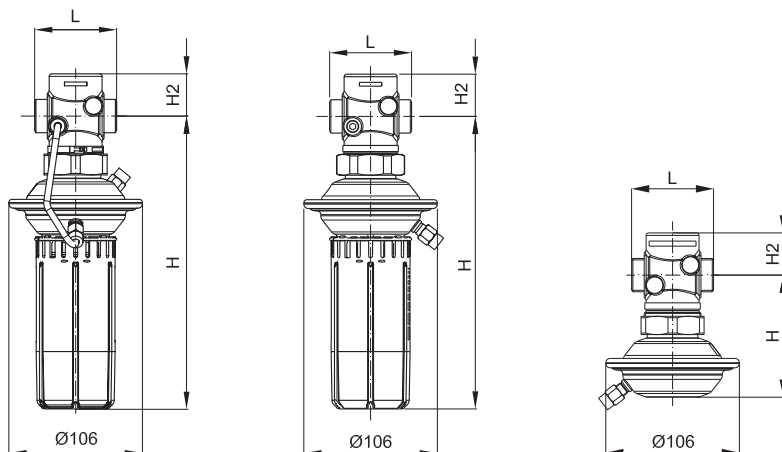


AVP (flow, return)

DN	L	H	H2	Weight (kg)
	mm			
15	65	232	34	1.7
20	70	232	34	1.8
25	75	232	38	1.9
32	100	232	38	2.2

AVP-F (return)

DN	L	H	H2	Weight (kg)
	mm			
15	65	97	34	1.3
20	70	97	34	1.4
25	75	97	38	1.5
32	100	97	38	1.8

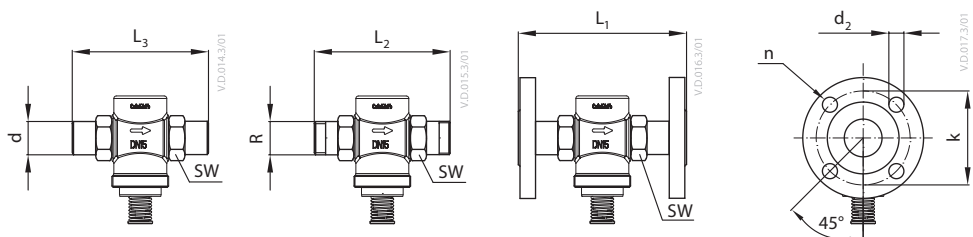


DN	R ¹⁾	SW	d	mm						n
				L ₁ ²⁾	L ₂	L ₃	k	d ₂		
15	½	32 (G ¾A)	21	130	120	139	65	14	4	
20	¾	41 (G 1A)	26	150	131	154	75	14	4	
25	1	50 (G 1¼A)	33	160	145	159	85	14	4	
32	1¼	63 (G 1¾A)	42	-	177	184	-	-	-	

¹⁾ Conical ext. thread acc. to EN 10226-1

²⁾ Flanges PN 25, acc. to EN 1092-2

Compression fittings

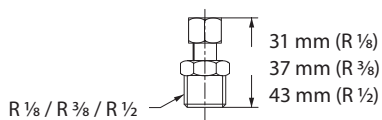



Danfoss A/S

Heating Segment • heating.danfoss.com • +45 7488 2222 • E-Mail: heating@danfoss.com

Danfoss can accept no responsibility for possible errors in catalogues, brochures and other printed material. Danfoss reserves the right to alter its products without notice. This also applies to products already on order provided that such alterations can be made without subsequential changes being necessary in specifications already agreed. All trademarks in this material are property of the respective companies. Danfoss and all Danfoss logotypes are trademarks of Danfoss A/S. All rights reserved.
